


UA88376-SSG-HW Dry Contact Relay Card (Hardwire Connection)

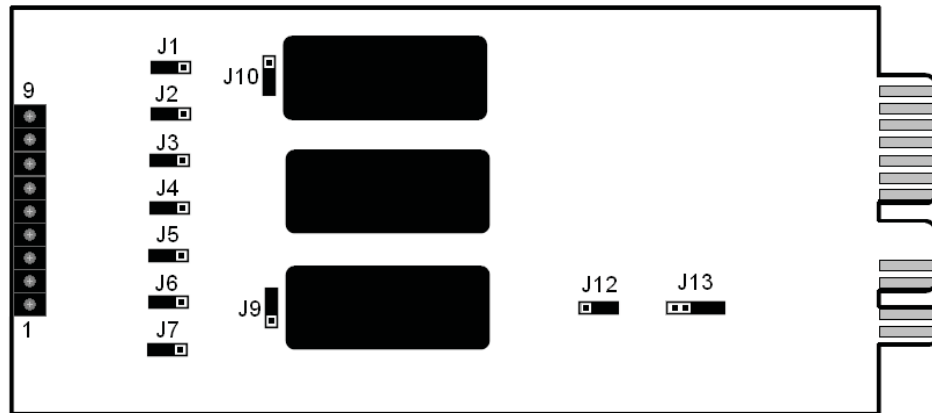

Default Jumper Configuration			
Jumper #	Designation	Default Setting	Status
J1-J7	Green Serial Cable	1-2	Closed
J9	Summary Alarm	1-2	Closed
J10	Low Battery	1-2	Open
J12	UPS Model	1-2	SSG Series
J13	On-Bypass	2-3	Enable

Terminal Designations	
Terminal #	Designation
1	Not Used
2	Utility Loss, Normally Open
3	Utility Loss, Normally Closed
4	Common (Tied to Pin #7)
5	Low Battery
6	Remote Shutdown (5-12VDC)
7	Common (Tied to Pin #4)
8	Alarm / Bypass
9	Not Used

Relay Contact Ratings:

✓ 48VDC Max

✓ 1 AMP Max

Note The Pin Designations Table provides relay contact positions while the UPS is turned on and in Online Operation.